

### FEATURES

- Printed glass touch panel (image customizable through web application)
- 1, 2, 4 or 6 touch areas
- 2 analog/digital inputs
- Thermostat
- Temperature sensor
- Backlighting of touch areas to indicate statuses
- Luminosity and proximity sensor
- Total data saving on KNX bus failure
- Integrated KNX BCU
- Dimensions 81 x 81 x 28mm
- Flush mount on back box
- Conformity with the CE directives (CE-mark on the back side)

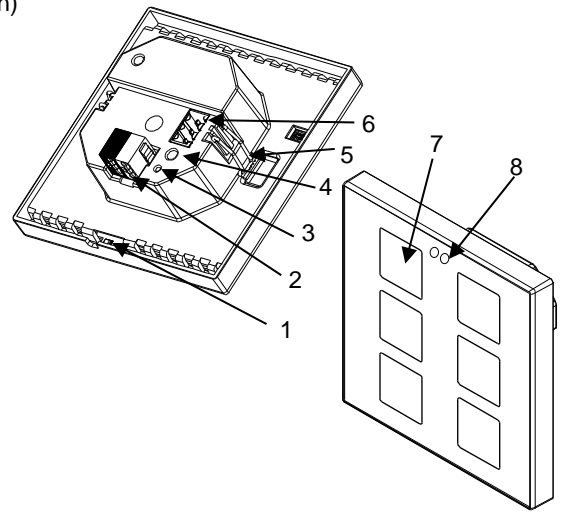


Figure 1: Flat X

1. Temperature sensor	2. KNX connector	3. Programming LED	4. Programming button
5. Fixing clips	6. Inputs connector	7. Touch area	8. Luminosity and proximity sensor

Programming button: short press to set programming mode. If this button is held while plugging the device into the KNX bus, it enters the safe mode.

Programming LED: programming mode indicator (red). When the device enters the safe mode, it blinks (red) every half second. During the start-up (reset or after KNX bus failure) and if the device is not in safe mode, it emits a red flash.

### GENERAL SPECIFICATIONS

CONCEPT		DESCRIPTION		
Type of device		Electric operation control device		
KNX supply	Voltage (typical)	29VDC SELV		
	Voltage range	21..31VDC		
	Maximum consumption	Voltage	mA	mW
		29VDC (typical)	ZVI-F6 (17)   ZVI-F4 (15.4)   ZVI-F2 (11.4)   ZVI-F1 (12.7)	ZVI-F6 (493)   ZVI-F4 (446.6)   ZVI-F2 (330.6)   ZVI-F1 (368.3)
24VDC <sup>1</sup>	ZVI-F6 (20)   ZVI-F4 (20)   ZVI-F2 (15)   ZVI-F1 (17.5)	ZVI-F6 (480)   ZVI-F4 (480)   ZVI-F2 (360)   ZVI-F1 (420)		
Connection type		Typical TP1 bus connector for 0.80mm Ø rigid cable		
External power supply		Not required		
Operation temperature		0°C .. +55°C		
Storage temperature		-20°C .. +55°C		
Operation humidity		5 .. 95%		
Storage humidity		5 .. 95%		
Complementary characteristics		Class B		
Protection class		III		
Operation type		Continuous operation		
Device action type		Type 1		
Electrical stress period		Long		
Degree of protection		IP20, clean environment		
Installation		Flush mount on back box		
Minimum clearances		Not required		
Response on KNX bus failure		Data saving according to parameterization		
Response on KNX bus restart		Data recovery according to parameterization		
Operation indicator		The programming LED indicates programming mode (red). Backlighting of touch areas depending on their / the parameterization.		
Weight		92g		
PCB CTI index		175V		
Housing material		PC+ABS FR V0 halogen free		

<sup>1</sup> Maximum consumption in the worst-case scenario (KNX Fan-In model).

INPUTS SPECIFICATIONS AND CONNECTIONS	
CONCEPT	DESCRIPTION
Number of inputs	2
Inputs per common	2
Operation voltage	+3.3VDC in the common
Operation current	1mA @ 3.3VDC (per input)
Switching type	Dry voltage contacts between input and common
Connection method	Pluggable screw terminal block
Cable cross-section	0.2-1.5mm <sup>2</sup> (IEC) / 28-14AWG (UL)
Maximum cable length	30m
NTC probe length	1.5m (extensible up to 30m)
NTC accuracy (@ 25°C) <sup>2</sup>	±0.5°C
Temperature resolution	0.1°C
Maximum response time	10ms


<sup>2</sup> For Zennio temperature probes.

INTERNAL TEMPERATURE SENSOR SPECIFICATIONS	
CONCEPT	DESCRIPTION
Measuring range	-30 .. +90°C
Temperature resolution	0.1°C
NTC accuracy (@ 25°C)	±0.5°C

## INPUTS CONNECTION

Any combination of the next **accessories** is allowed on the inputs:

### Temperature Probe\*\*



Zennio temperature probe.


### Motion Sensor



Up to two motion sensors can be plugged into the same device input (parallel wiring)

Screw terminal for connecting Zennio motion sensors\*

### Switch/Sensor/ Push button




\* In case of using ZN110-DETEC-P sensor, its micro switch number 2 must be in **Type B position**.

\*\* May be a Zennio temperature probe or any NTC with known resistance values at three points in the range [-55, 150°C].

## INSTALLATION INSTRUCTIONS

1. Please, fix the metal plate into a square or round flush box with the screws from the box.
2. Connect the KNX bus and the inputs terminal to the back of the device.
3. Fit the device into its final position and check that the strength of the clips is enough to fix the device.

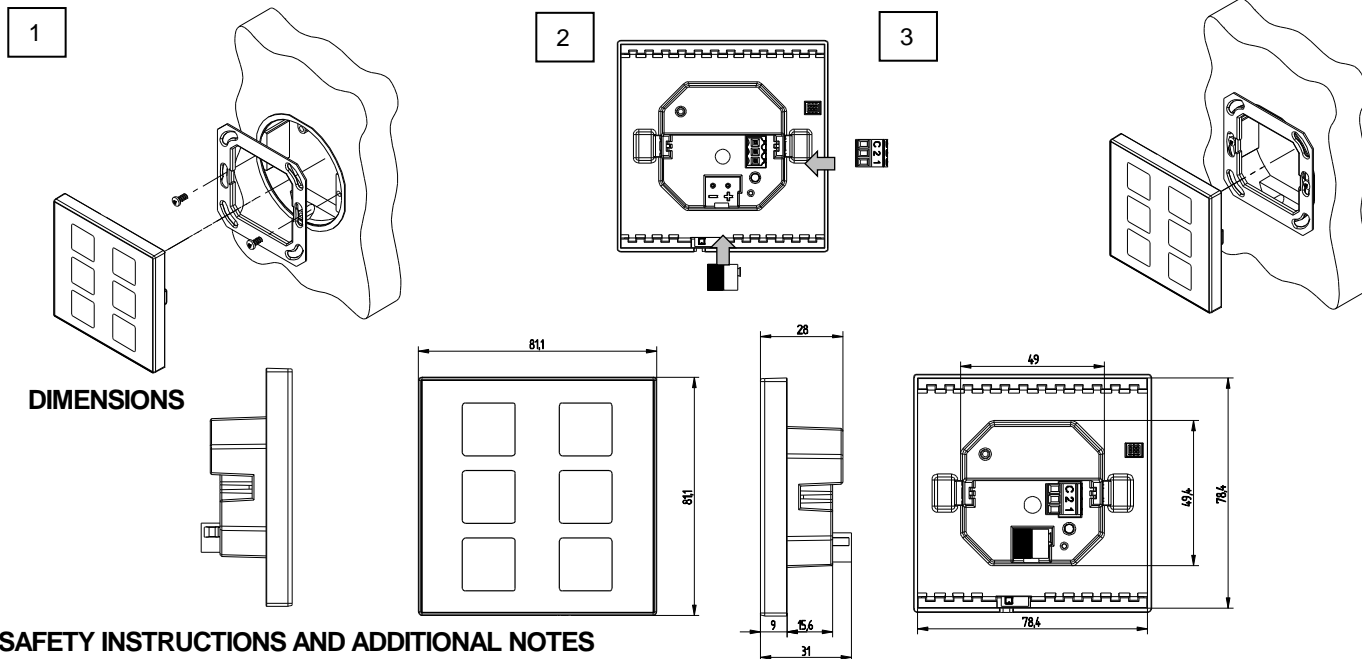

## SAFETY INSTRUCTIONS AND ADDITIONAL NOTES

- Installation should only be performed by qualified professionals according to the laws and regulations applicable in each country.
- Do not connect the mains voltage nor any other external voltage to any point of the KNX bus; it would represent a risk for the entire KNX system. The facility must have enough insulation between the mains (or auxiliary) voltage and the KNX bus or the wires of other accessories, in case of being installed.
- Keep the device away from water (condensation over the device included) and do not cover it with clothes, paper or any other material while in use.
- The WEEE logo means that this device contains electronic parts and it must be properly disposed of by following the instructions at <https://www.zennio.com/en/legal/wEEE-regulation>.
- This device contains software subject to specific licences. For details, please refer to <http://zennio.com/licenses>.