


HOW COULD I KNOW IF A PANASONIC SYSTEM CAN BE CONTROLLED WITH ZENNIO GATEWAYS?

1. Identify the model of **indoor units** in the system.

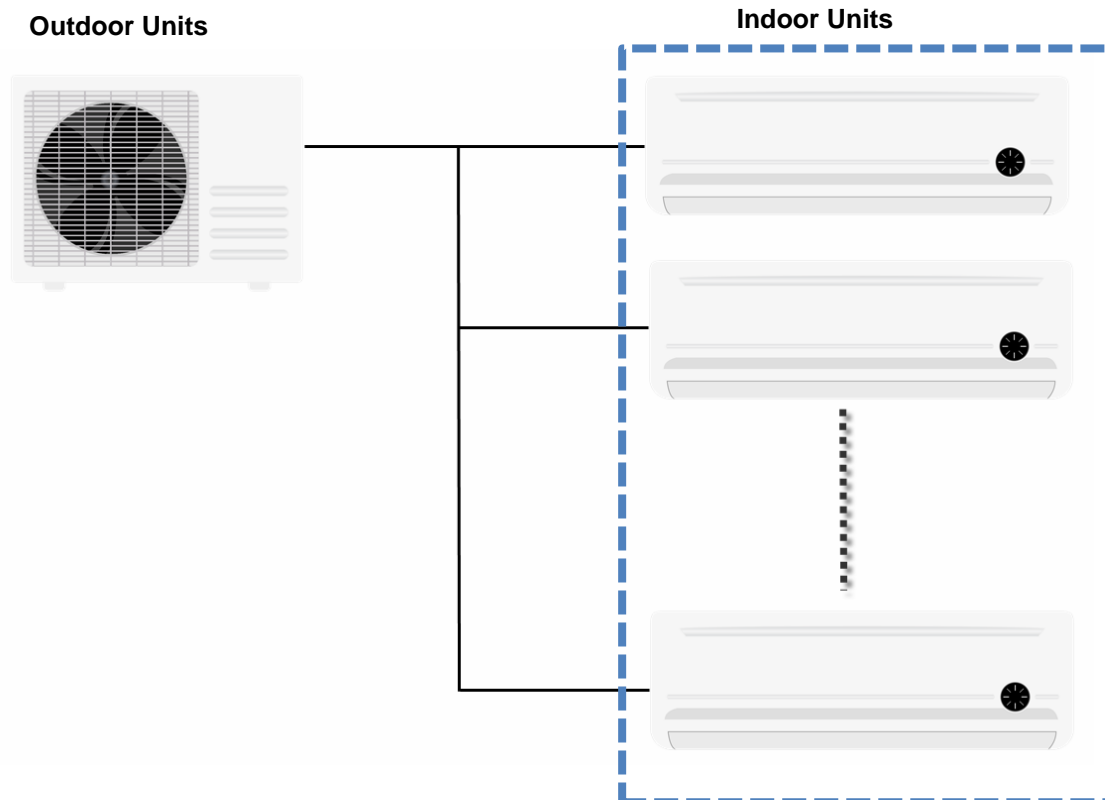

2. You should extract the characters corresponding to the model of indoor unit. Below you can see some examples of indoor units and the characters that correspond to the model:

	Outdoor unit	Indoor unit		Table model
Cassette	U-8LE1E8	S-56MU1E5A	→	S-_MU1E5A
Ducts	U-60PEY1E5	S-60PF1E5A	→	S-_PF1E5A
Ceiling	U-50PE1E5	S-50PT2E5A	→	S-_PT2E5A

3. **Find that model in the compatibility table below** and check if it is compatible with KLIC-PA.

If a model of PANASONIC indoor unit is not in this list, please, consult with **Zennio Technical Support** <http://support.zennio.com>

COMPATIBILITY OF PANASONIC INDOOR UNITS WITH KLIC-PA

SERIES	TYPE	INDOOR UNIT MODEL
ECOi & ECOiEX	Cassette	S-_MD1E5
		S-_ML1E5
		S-_MU1E5(A)
		S-_MU2E5(A)
		S-_PU1U6
		S-_MY1E5
		S-_MY2E5A
	Ducted	S-_MF1E5(A)
		S-_MF2E5(A)
		S-_PF1U6
		S-_MM1E5(A)
		S-_ME1E5/_ME2E5
	Ceiling	S-_MT1E5
		S-_MT2E5A
		S-_PT1U6
	Wall Mounted	S-_MK1E5(A)
		S-_MK2E5A
	Floor	S-_MP1E5
		S-_MR1E5
PACi	Cassette	S-_PU1E5(A)
		S-_PU2E5A
		S-_PU1R5A
		S-_PU1U6/_PU2U6
		S-_PY1E5
		S-_PY2E5A
	Ceiling	S-_PT1E5
		S-_PT2E5(A)
		S-_PT2R5A
		S-_PT1U6/_PT2U6
	Wall Mounted	S-_PK1E5(A)
		S-_PK1U6/_PK2U6
	Ducted	S-_PF1E5(A)
		S-_PF1R5(A)

PACi	Ducted	S-_PF1U6/_PF2U6
		CS-E_SD3UAW
		S-_PN1E5(A)
		S-_PE1E5/_PE2E5
		S-_PE1E8
		S-_PE1R5A_PE1R5/B
		S-200PE2R5
		S-140PE2R5B
		S-_PE3R5